


流入水、放流水の水質経年変化(1988～2022年度)

宍道湖西部浄化センター

水質データ経年変化

T-P (全りん)

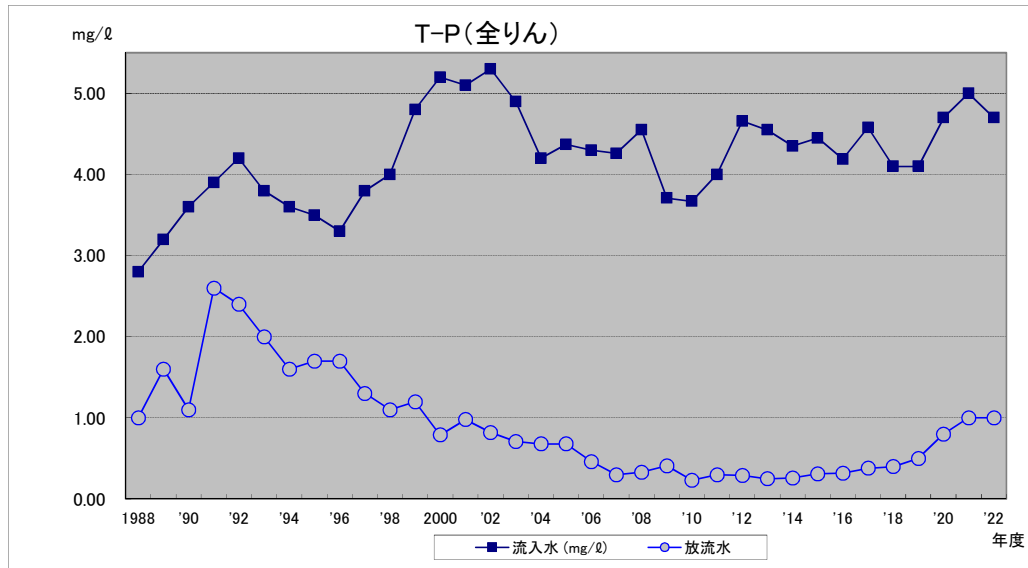

T-P (全りん)

	流入水	放流水
	(mg/l)	
1988	2.80	1.00
'89	3.20	1.60
'90	3.60	1.10
'91	3.90	2.60
'92	4.20	2.40
'93	3.80	2.00
'94	3.60	1.60
'95	3.50	1.70
'96	3.30	1.70
'97	3.80	1.30
'98	4.00	1.10
'99	4.80	1.20
2000	5.20	0.79
'01	5.10	0.98
'02	5.30	0.82
'03	4.90	0.71
'04	4.20	0.68
'05	4.37	0.68
'06	4.30	0.46
'07	4.26	0.30
'08	4.55	0.33
'09	3.71	0.41
'10	3.67	0.23
'11	4.00	0.30
'12	4.66	0.29
'13	4.55	0.25
'14	4.35	0.26
'15	4.45	0.31
'16	4.19	0.32
'17	4.58	0.38
'18	4.10	0.40
'19	4.10	0.50
'20	4.70	0.80
'21	5.00	1.00
'22	4.70	1.00